

## A481 Series

### MODEL A481400S

FULLY RECESSED, WALL MOUNTED  
DRINKING FOUNTAIN

#### STANDARD FEATURES

- 18 gage, 304 stainless steel cabinet
- 16 gage, galvanized mounting frame
- Polished Stainless Steel, anti-rotation, non-squirt bubbler
- 100 mesh inlet strainer
- Vandal resistant screws



“INDOOR USE ONLY”

#### SUGGESTED SPECIFICATIONS

Model A481400S is a fully recessed, wall mounted drinking fountain made from 18 gage, 304 stainless steel with a brushed finish. Unit shall be activated by a surface mounted, chrome plated brass front pushbutton using less than 5 pounds of force. Bubbler shall be Stainless Steel, with an integrally designed non-squirt feature and operates on a water pressure range of 20-105 psig. Unit shall be certified to Public Law 111-380 (NO-LEAD) and NSF/ANSI/CAN 61. Optional WF3000 PFAS Water Filter shall have 3000 gallon capacity with 3rd Party Certification for Lead, Bacteria, Chlorine, Microplastics, and NSF/ANSI for Cyst and total PFAS reduction.

#### MODEL:

(Must Specify)

- |                                   |                         |
|-----------------------------------|-------------------------|
| <input type="checkbox"/> A481400F | Flexible Bubbler        |
| <input type="checkbox"/> A481400S | Stainless Steel Bubbler |

#### OPTIONS

(additional costs may be incurred)

- |                               |              |
|-------------------------------|--------------|
| <input type="checkbox"/> -GF2 | Glass filler |
| <input type="checkbox"/> -HP  | High Polish  |

#### ACCESSORIES

(additional costs may be incurred)

- |                                  |   |
|----------------------------------|---|
| <input type="checkbox"/> -WF3000 | 3000 gallon PFAS Water Filter ( <b>See Note *</b> ) <sup>1</sup><br>NSF/ANSI, PFAS, Lead, Bacteria, Chlorine, Microplastics |
| <input type="checkbox"/>         | A9100080-A 8 GPH Remote Water Chiller<br>(Recommended to be with 10 Feet of Fixture)  |

#### NOTES:

1- Refer to Supplemental Submittal Sheet for Complete Product details.

\* NOTE: For Optional -WF3000:  
Installer Responsible for Remotely Locating Water Filter.

Complies  
with the  
following  
standards:



Federal  
Public Law  
111-380  
(No Lead)

NSF/ANSI/CAN 61-2020

[3000 Gallon PFAS Filter Certifications](#)


[Product Warranty](#)

⚠ WARNING: Cancer and Reproductive Harm - [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)

**A481 Series**

**MODEL A481400S**

FULLY RECESSED, WALL MOUNTED  
DRINKING FOUNTAIN

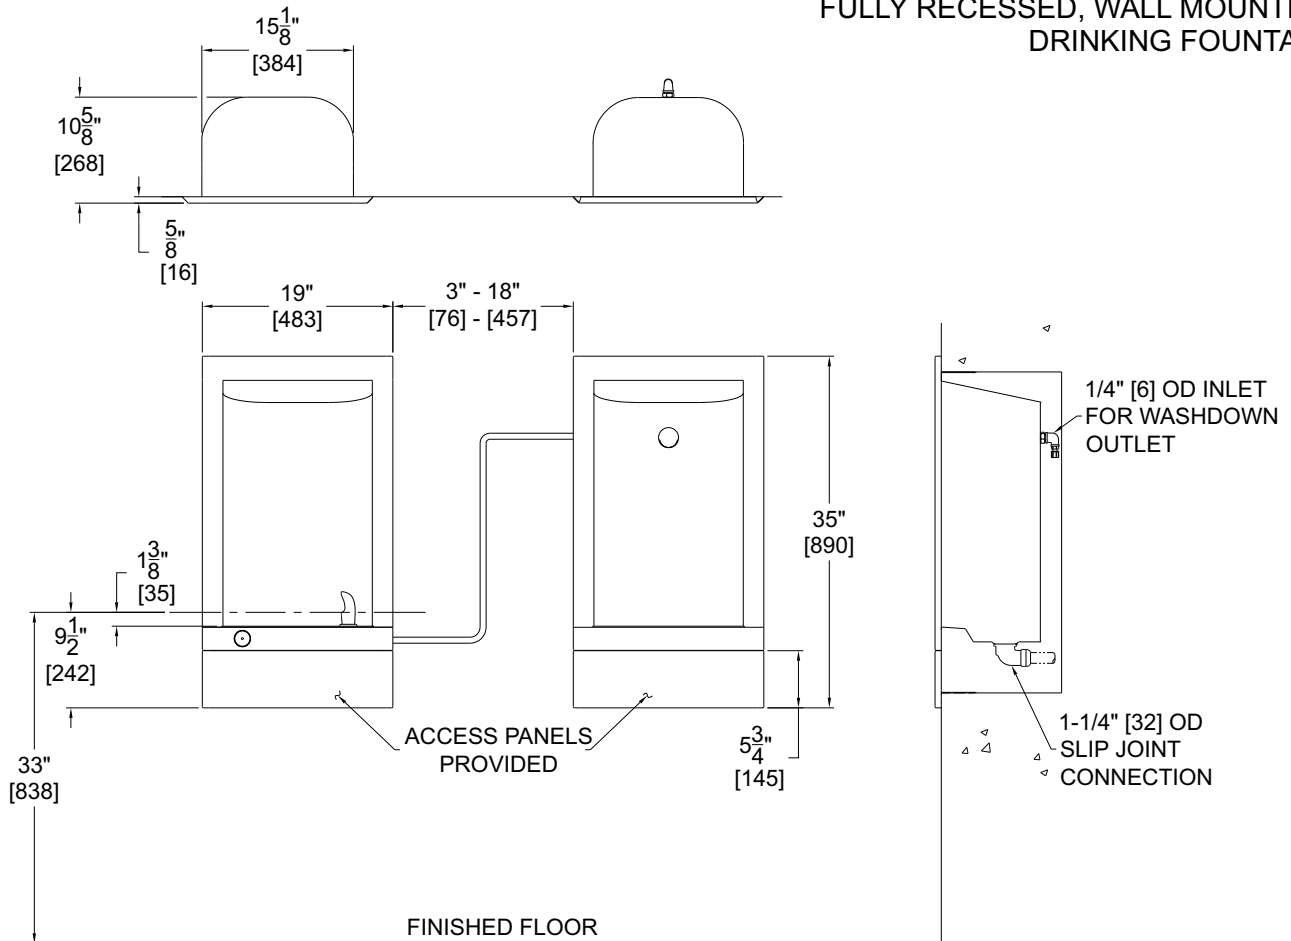

**GENERAL NOTES:**

1. ALL DIMENSIONS ARE IN INCHES [MM].
- \*2. DIMENSIONS SHOWN ARE FOR RECOMMENDED ADULT HEIGHT.  
ADJUST VERTICAL DIMENSIONS AS NECESSARY TO COMPLY WITH  
FEDERAL, STATE, & LOCAL CODES.
3. STOP VALVE NOT PROVIDED.

<b>SELECTION SUMMARY &amp; APPROVAL FOR MANUFACTURING</b>	Model Number & Options _____	Quantity _____	<p><i>All dimensions are subject to manufactures tolerance of plus or minus 1/4" nominal and subject to change without notice. Murdock<sup>®</sup> assumes no responsibility for use of void or superseded data. Dimensions may change with the addition of optional accessories. Murdock<sup>®</sup> Mfg., Member of Morris Group International<sup>®</sup>. Please visit <a href="http://www.murdockmfg.com">www.murdockmfg.com</a> for most current specifications.</i></p>
	Company _____		
	Contact _____	Title _____	
	Signature (Approval for Manufacturing) _____	Date _____	