



# Water Coolers

## SIMULATED SEMI-RECESSED DRINKING FOUNTAIN

### F130PM

#### Suggested Specification

Model F130PM is a non-refrigerated, semi-recessed stainless steel drinking fountain for direct connection to a cold water supply or for use with remote water chillers. Model F130PM shall have a mechanical push-button on the front of the cabinet. Water flows as long as the button is depressed. Cabinet shall be brushed stainless steel. Shall be listed by Underwriters' Laboratories to U.S and Canadian standards and conform to European Union Directives.

#### Model

F130PM is a non-refrigerated, semi-recessed stainless steel drinking fountain for direct connection to a cold water supply or for use with remote water chillers.

#### Standard Features

- > Waterways are Lead-Free in Materials & Construction
- > Single Push-Button On Cabinet Front Keeps Water Flowing While Button Is Depressed
- > Satin Finish Stainless Steel Surfaces
- > Built-in Pressure Regulator Assures Smooth, Steady Water Flow
- > Anti-Splash Ridge and Integral Strainer Grid
- > Bottom Cover Plate
- > Product Certified to NSF/ANSI Standard 61, Annex G (AB1953)
- > Limited 1-Year Warranty

#### Finishes

- > Standard Cabinet Finish: Stainless Steel
- > Optional Cabinet Finish at extra cost: Regency Bronze

#### Installation

- > Prior to roughing-in, consult local, state and federal codes for proper mounting height.
- > Shipped with complete instructions and wall mounting bracket.



Components in this fountain are lead free as defined by the Safe Drinking Water Act Amendments of 1986, and the Lead Contamination Control Act of 1988.

**Limited 1-Year Warranty** (Continental limits of the United States and Canada): One year from date of installation on parts only.

**Export Warranty:** One year on component parts.

Product Certified to NSF/ANSI Standard 61, Annex G (weighted average lead content of  $\leq 0.25\%$ ) and is in compliance with California's Health & Safety Code Section 116875 (commonly known as AB1953).

Models covered by this specification comply with all known Plumbing Codes. Listed by Underwriters' Laboratories to U.S. and Canadian standards and conform to European Union Directives.




Certified to NSF/ANSI 61-G

Physical Dimensions In Inches

Model	Style	Height	Width	Depth	Extended From Wall	Net Weight Approx.
F130PM	Simulated Semi-Recessed	27 3/4"	17 5/16"	9 1/2"	9 1/2"	13 lbs.


# OASIS™ SIMULATED SEMI-RECESSED DRINKING FOUNTAIN MODEL F130PM

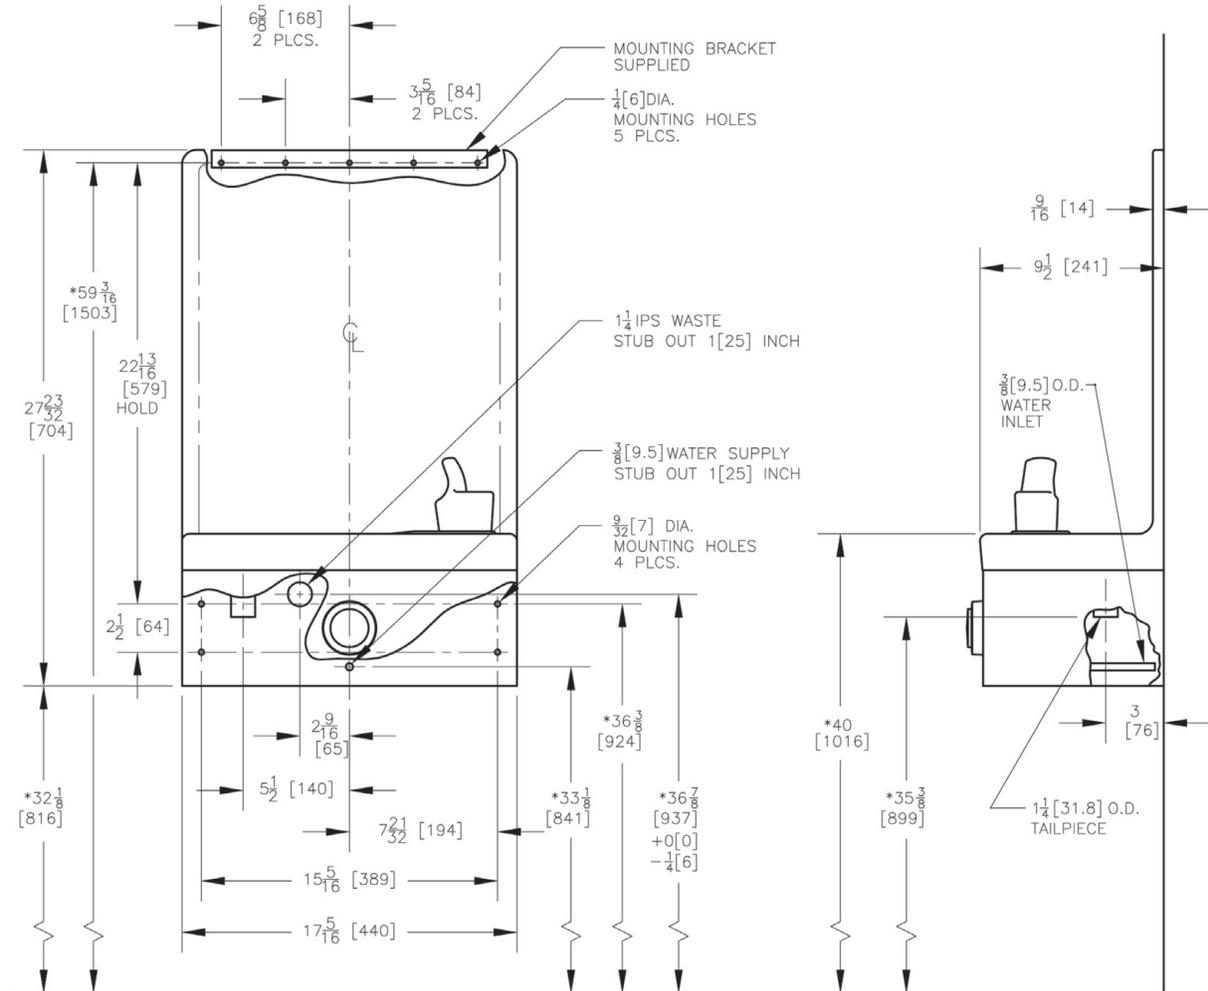

**NOTES:**

1. TRAP AND STOP VALVE NOT FURNISHED.
- \*2. RECOMMENDED ADULT HEIGHT INSTALLATION SHOWN. ADJUST VERTICAL DIMENSIONS AS REQ'D TO COMPLY WITH FEDERAL, STATE, AND LOCAL CODES.
3. ALL DIMENSIONS ARE IN INCHES. DIMENSIONS IN BRACKETS [ ] ARE IN MILLIMETERS.
4. THE FOLLOWING STATES REQUIRE A LICENSED PLUMBER TO INSTALL FOUNTAIN; AR, GA, MA, MI, OK, RI, SC, SD, TX, VT AND WI. CA, KS, MN, NM, AND OR ALLOW FOR A STATE REGISTERED INSTALLER OR CONTRACTOR AS WELL. STATE AND LOCAL PLUMBING CODES MAY PROHIBIT THE USE OF SADDLE TAPPING VALVES FOR WATER LINE CONNECTION IN SOME APPLICATIONS. ALL CONNECTIONS MUST CONFORM TO APPLICABLE PLUMBING CODES.

THIRD ANGLE PROJECTION



ROUGHING-IN  
AND  
DIMENSIONAL DRAWING